



# 产品认证证书

证书编号：CQC2019010307203375

**申请人名称及地址**

德力西电气（芜湖）有限公司  
安徽省芜湖市芜湖机械工业园

**制造商名称及地址**

德力西电气有限公司  
浙江省乐清市柳市镇德力西高科技工业园区

**生产企业名称及地址**

德力西电气有限公司(V010114)  
浙江省乐清市柳市镇德力西高科技工业园区

**产品名称和系列、规格、型号**

万能式断路器  
CDW9-6300N；详情见附件

**产品标准和技术要求**

GB/T14048.2-2008

**认证模式**

型式试验+初始工厂检查+获证后监督

上述产品符合 CQC11-462141-2019 认证规则的要求，特发此证。

发证日期：2020年04月27日 有效期至：2024年01月30日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

主任：\_\_\_\_\_

陆梅



## 中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>

C 0238964



# 产品认证证书

附 录

第 1 页 共 2 页

证书编号: CQC2019010307203375

纸 号: 238964

CDW9-6300N

额定冲击耐受电压( $U_{imp}$ ): 12kV;

额定绝缘电压( $U_i$ ): 1000V;

额定工作电压( $U_e$ ): AC400V/415V, AC600V/690V;

额定电流( $I_n$ ): 4000A, 5000A, 6300A;

过电流脱扣器类型: 电子式;

额定运行短路分断能力  $I_{cs}$ : 100kA (AC400V/415V), 75kA (AC660V/690V);

额定极限短路分断能力  $I_{cu}$ : 120kA (AC400V/415V), 85kA (AC660V/690V);

额定短时耐受电流  $I_{cw}$ : 85kA/1s (AC400V/415V), 75kA/1s (AC660V/690V);

使用类别: B;

极数: 3P (4000A, 5000A, 6300A), 4P (4000A, 5000A);

适用于隔离;

额定频率: 50/60Hz;

配用的辅助触头 (4NO+4NC):

$I_{th}$ : 6A;

AC-15:  $U_e/I_e$ : AC230V/1.5A,  $U_e/I_e$ : AC400V/0.9A;

DC-13:  $U_e/I_e$ : DC110V/0.55A,  $U_e/I_e$ : DC220V/0.27A;

符合附录 N 的电子附件:

欠压脱扣器 MN:  $U_s$ : AC220/230V, AC380/400V;

分励脱扣器 MX:  $U_s$ : DC110V, DC220V, AC220/230V, AC380/400V.

注: 此附录与证书同时使用时有效。

主任: \_\_\_\_\_

陆梅



## 中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



# 产品认证证书


附 录

第 2 页 共 2 页

证书编号: CQC2019010307203375

纸 号: 238964

型号解释:

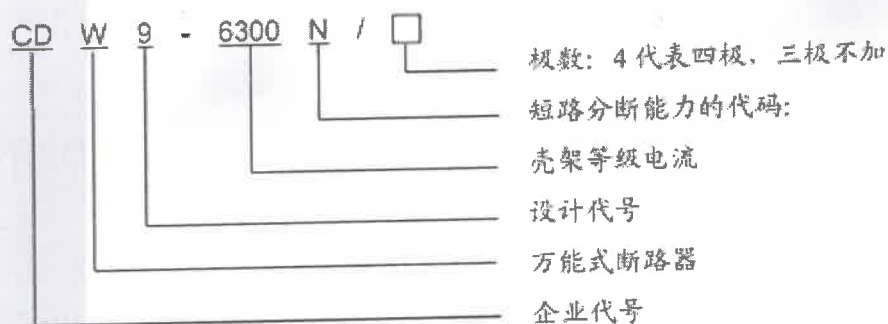

注: 此附录与证书同时使用时有效。

主任: 陆梅



## 中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



# PRODUCT CERTIFICATE

**CERTIFICATE NO.:** CQC2019010307203375

**NAME AND ADDRESS OF THE APPLICANT**

DELIXI ELECTRIC (WUHU) LTD  
Wuhu Machinery Industrial Park, Wuhu City, Anhui Province, 241100, P.R.China

**NAME AND ADDRESS OF THE MANUFACTURER**

DELIXI ELECTRIC LTD.  
Delixi High Tech Industrial Park, Liushi Town, Yueqing City, Zhejiang Province, 325604, P.R.China

**NAME AND ADDRESS OF THE FACTORY**

DELIXI ELECTRIC LTD. (V010114)  
Delixi High Tech Industrial Park, Liushi Town, Yueqing City, Zhejiang Province, 325604, P.R.China

**PRODUCT NAME, MODEL AND SPECIFICATION**

Conventional Circuit-breaker  
CDW9-6300N; See the appendix

**THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS**

GB/T14048.2-2008

**TYPE OF CERTIFICATION SCHEMES**

Type testing of product + initial factory inspection + follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC11-462141-2019 .

Valid from: Apr.27,2020

Valid until: Jan.30,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

**President:** \_\_\_\_\_

Lu Mei



## CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China  
<http://www.cqc.com.cn>

C 0238964